


DRINK WELL DO WELL

LAVIT



Installer Specifications

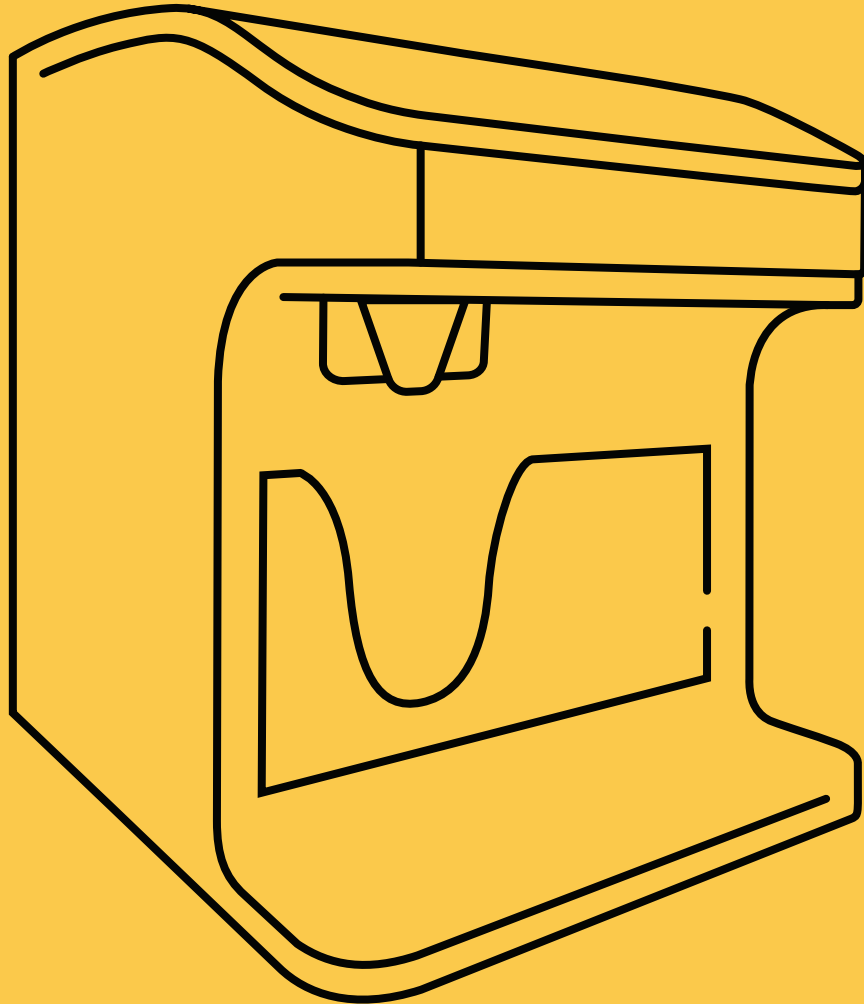

LAVIT

INSTALLER SPECIFICATIONS

- ✓ ¼" NSF approved water tubing
- ✓ Water supply Min- 40 psi Max 60 psi If water supply is under 40psi a booster pump must be installed. *This is not supplied by Lavit and is the installers responsibility.*
- ✓ If the water pressure exceeds 60 psi a pressure reducing valve is needed (¼" quick connect fittings is recommended). All coolers shipped after July of 2019 come with a pressure reducing valve in the packaging. Install where needed.
- ✓ ¼" Shut off valve
- ✓ Electrical 115v 60Hz, 2 A/230 W

NOTE: It is the responsibility of the installer to follow local and state codes during the installation of the Lavit cooler.

**For technical assistance
call 1-855-750-5377**